RIGHT TESTING LABS

4767 Clark Howell Hwy, Suite 7
Atlanta, GA 30349
(678) 705-1006
www.righttestinglabs.com

ASTM E84-18 Fire Test Report

Issued to **Extrutech Plastics, Inc.**

Product ID **P 824-Low Smoke (Concrete Wall Form)**

Scope of Evaluation

Fire Testing to ASTM E84-18 "Standard Method of Test for Surface Burning Characteristics of Building Materials".

Test Report Number
RTL0015-1

Date of Test
January 21, 2020

Report Issued on
January 21, 2020

Record Kept until
January 20, 2024

Report Template Control Number
Test Report; V1.5_9-26-2019

Number of Pages in Report
8

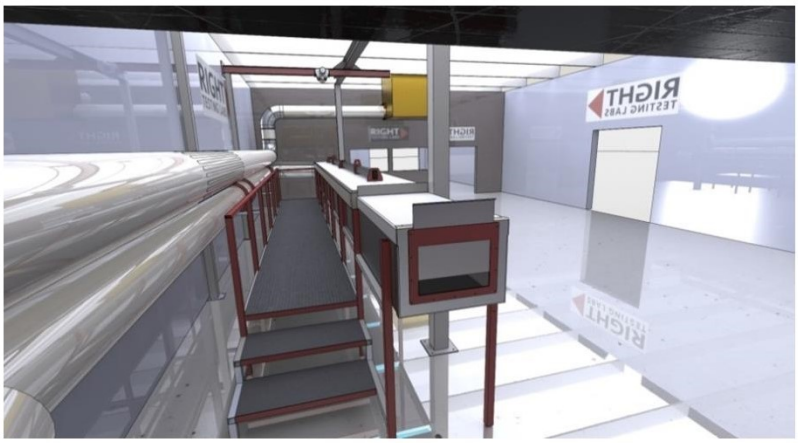

RIGHT TESTING LABS

4767 Clark Howell Hwy, Suite 7
Atlanta, GA 30349
(678) 705-1006
www.righttestinglabs.com

Report Issued To:
Extrutech Plastics, Inc.
5902 West Custer Street
Manitowoc, WI 54220
USA

Proposal Number: SSP-10092019-01 via PO 5400014755
Acceptance Date: Wednesday, January 15, 2020
Accepted By: M. Wilda

Product ID: P 824-Low Smoke (Concrete Wall Form)
as stated by client.

Witnesses of Test: Drew Mersereau-RTL and Scott Parkhurst-RTL

Test Result:

Flame Spread Index (FSI)	Smoke Developed Index (SDI)
15	400

**See Details of Evaluation on the subsequent pages of this report.*

Classification: **A**

Prepared by

Name: **Drew Mersereau**
Title: *Senior Project Manager*
Date: January 21, 2020

Signed for and on the behalf of
Right Testing Laboratories, LLC.

Scott Parkhurst
Laboratory Manager
January 21, 2020