



TEST REPORT

ASTM E84-09

SURFACE BURNING CHARACTERISTICS OF BUILDING MATERIALS

**“ P2400 – 24” ”
24” Wall & Ceiling Panel – AP 1269**

Report No. 3197912SAT-001E.REV1

January 25, 2010

Prepared For:

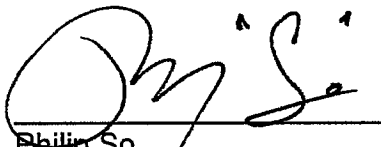
Extrutech Plastics, Inc.
5902 Custer St.
Manitowoc, WI 54220

Intertek Testing
Services NA, Inc.
16015 Shady Falls Road
Elmendorf, TX 78112
(voice) 210-635-8100
(fax) 210-635-8101
[www.intertek-
etlsemko.com](http://www.intertek-etlsemko.com)

ABSTRACT


Test Material:	“ P2400 – 24” ”	
Test Standard:	ASTM E84-09 TEST FOR SURFACE BURNING CHARACTERISTICS OF BUILDING MATERIALS (UL 723, UBC 8-1, NFPA 255)	
Test Date:	November 21, 2009	
Test Sponsor:	Extrutech Plastics, Inc.	
Test Results:	FLAME SPREAD INDEX	15
	SMOKE DEVELOPED INDEX	350

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of the report. Only the Client is authorized to copy or distribute this report and then only in its entirety. Any use of Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.


Philip So
Tunnel Operator

Date: January 25, 2010

Reviewed and Approved:


Miguel Zamarripa
Project Manager

Date: January 25, 2010

